

2 May 2023

TL238-03F01 Carpet Floor Impact Test - Mist Range Sample (r1)

Inspired Floorcoverings

Jarod Hainey

jarod@inspiredfc.com.au

From: Tony Wong [Tony.Wong@renzotonin.com.au]

Inspired Floorcoverings - Field Impact Sound Insulation Test Report - Mist Range Carpet Tile

1 Introduction

Renzo Tonin & Associates was engaged by Inspired Floorcoverings to conduct acoustic testing of a sample of the Mist Range carpet tile at 25 Pittwater Road, Manly to determine its impact sound insulation performance. The test results will be compared to the sound insulation requirements of the National Construction Code (NCC) Part F5.

The work documented in this report was carried out in accordance with the Renzo Tonin & Associates Quality Assurance System, which is based on Australian Standard / NZS ISO 9001.

2 Acoustic Requirements

Internal walls and floors of Class 2 and Class 3 buildings shall comply with the National Construction Code of Australia 2019 (formally Building Code of Australia). All services and doors shall comply with the requirements of the NCC 2019. Relevant sections of the NCC are reproduced below:

FV5.1 Sound transmission through floors [FP5.1 and FP5.3]

Compliance with FP5.1 and FP5.3 to avoid the transmission of airborne and impact generated sound through floors is verified when it is measured in-situ that the separating floor has—

(a) airborne: a weighted standardised level difference with spectrum adaptation term ($D_{nT,w} + C_{tr}$) not less than 45 when determined under AS/NZS ISO 717.1; and

(b) impact: a weighted standardised impact sound pressure level ($L_{nT,w}$) not more than 62 when determined under AS ISO 717.2.

FV5.2 Sound transmission through walls [FP5.2(a) and FP5.3]

Compliance with FP5.2(a) and FP5.3 to avoid the transmission of airborne sound through walls is verified when it is measured in-situ that—

(a) a wall separating sole-occupancy units has a weighted standardised level difference with spectrum adaptation term ($D_{nT,w} + C_{tr}$) not less than 45 when determined under AS/NZS ISO 717.1; or

(b) a wall separating a sole-occupancy unit from a plant room, lift shaft, stairway, public corridor, public lobby, or the like, or parts of a different classification, has a weighted standardised level difference ($D_{nT,w}$) not less than 45 when determined under AS/NZS ISO 717.1; or

(c) any door assembly located in a wall that separates a sole-occupancy unit from a stairway, public corridor, public lobby, or the like, has a weighted standardised level difference ($D_{nT,w}$) not less than 25 when determined under AS/NZS ISO 717.1.

As per Clause (b) of Part FV5.1 of the NCC, the impact sound insulation rating ($L_{nT,w}$) of an inter-tenancy floor/ceiling system measured in-situ is required to be no greater than 62 ie. $L_{nT,w} \leq 62$.

3 Methodology

The floor impact test was conducted in the bedroom of Unit 201 on Level 2 (Source room) on 01/05/2023. A sample of the Mist Range carpet tile was adhered to concrete slab floor of the bedroom for the purpose of acoustic testing. The transmitted impact sound pressure levels were measured in bedroom of the apartment immediately below, Unit 101 on Level 2 (Receiver room), which have identical floor plans.

The impact sound insulation tests were conducted in accordance with the following International Standards:

- ISO 16283-2 "Acoustics — Field measurement of sound insulation in buildings and of building elements — Part 2: Impact sound insulation"
- ISO 717-2 "Acoustics – Rating of sound insulation in buildings and of building elements – Part 2: Impact sound insulation".
- ISO 3382-2 "Acoustics — Measurement of room acoustic parameters — Part 2: Reverberation time in ordinary rooms"

4 Test Procedure

4.1 Floor Impact Test

Floor impact sound insulation test was conducted according to the following procedure:

1. A tapping machine was operated in different positions on the sample floor in accordance with ISO Standard indicated above in Section 3.
2. Noise levels were recorded in a minimum of two manually scanned microphone positions for each tapping machine position in receiver room with an averaging time of 30 seconds for each measurement.
3. The reverberation time of the receiver room was measured in accordance with ISO 3382-2 referenced above.

4.2 Instrumentation

The average sound pressure level was obtained by using a Bruel & Kjaer Type 2250 Sound Level Meter. The measured noise levels were filtered simultaneously in all one-third octave frequency bands in real time. These values were recorded and subsequently statistically analysed to determine the average sound pressure levels for each room and to indicate the precision of the measurements.

The Sound Level Meter has current NATA certification and was checked before and after the measurement for calibration using a Bruel and Kjaer Type 4231 Calibrator. The sound level meter conforms to a Type 1 instrument as defined in IEC 651 - 1979 'Sound Level Meters'. No significant drift in calibration was noted.

5 Test Results

The results the impact test and comparison with the corresponding acoustic requirements of the NCC are presented in Table 1 below.

Table 1. Summary of test results and comparison with NCC

Test No.	Floor/Ceiling System Tested	Measured Sound Insulation Ratings	NCC Sound Insulation Requirement	Comply with NCC?
Impact Sound Insulation Tests				
1	<p><u>Floor finish in Bedroom of Unit 201:</u> A sample of Inspired Floorcoverings Mist Range carpet tile adhered to 200mm concrete slab. The Mist Range specification are: <i>Yarn System: 100% Solution Dyed Yarn</i> <i>Construction: High Low Loop</i> <i>Pile Weight: 20 Oz (567gram)</i> <i>Pile Height: 5.5mm</i> <i>Total Thickness: 7mm</i> <i>Gauge: 1/12</i></p> <p><u>Ceiling beneath in Bedroom of Unit 101:</u> 13mm standard plasterboard suspended a minimum of 100mm off slab soffit with no insulation in ceiling cavity.</p>	<p>$L_{nT,w} = 46$</p> <p>and</p> <p>$FIIC^1 = 61$</p>	$L_{nT,w} \leq 62$	Yes
AAAC Star Rating of Tested Floor System ²		★★★★ (4 Stars)		

Test No.	Floor/Ceiling System Tested	Measured Sound Insulation Ratings	NCC Sound Insulation Requirement	Comply with NCC?
----------	-----------------------------	-----------------------------------	----------------------------------	------------------

Notes:

1. Field Impact Isolation Class (FIIC) determined in accordance with ASTM E989-89 "Determination of Impact Insulation Class (IIC)"
2. Association of Australasian Acoustical Consultants AAAC (Maximum of 6 Stars)

6 Conclusion

Renzo Tonin & Associates have completed acoustic testing of a sample of the Mist Range carpet tile at 25 Pittwater Road, Manly. The test results have shown the carpet tile range to comply with the impact sound insulation requirement of the Part F5 of National Construction Code. The Mist carpet tile achieved an impact sound insulation rating $L_{nT,w}$ of 46 which is equivalent to a 4 Star AAAC rating.

Copy of the acoustic test certificate is attached in APPENDIX A.

Document control

Date	Revision history	Non-issued revision	Issued revision	Prepared	Authorised
02.05.2023	Prepare test report & certificates	0	1	T. Wong	T. Wong

File Path: R:\AssocSydProjects\TL201-TL250\TL238 tw Inspired Floorcovering, Glenmore Park\T3 Manly Test 2\1 Docs\TL238-03F01 Carpet Floor Impact Test - Mist Range Sample (r1).docx

Important Disclaimers:

The work presented in this document was carried out in accordance with the Renzo Tonin & Associates Quality Assurance System, which is based on Australian/New Zealand Standard AS/NZS ISO 9001.

This document is issued subject to review and authorisation by the suitably qualified and experienced person named in the last column above. If no name appears, this document shall be considered as preliminary or draft only and no reliance shall be placed upon it other than for information to be verified later.

This document is prepared for the particular requirements of our Client referred to above in the 'Document details' which are based on a specific brief with limitations as agreed to with the Client. It is not intended for and should not be relied upon by a third party and no responsibility is undertaken to any third party without prior consent provided by Renzo Tonin & Associates. The information herein should not be reproduced, presented or reviewed except in full. Prior to passing on to a third party, the Client is to fully inform the third party of the specific brief and limitations associated with the commission.

In preparing this report, we have relied upon, and presumed accurate, any information (or confirmation of the absence thereof) provided by the Client and/or from other sources. Except as otherwise stated in the report, we have not attempted to verify the accuracy or completeness of any such information. If the information is subsequently determined to be false, inaccurate or incomplete then it is possible that our observations and conclusions as expressed in this report may change.

We have derived data in this report from information sourced from the Client (if any) and/or available in the public domain at the time or times outlined in this report. The passage of time, manifestation of latent conditions or impacts of future events may require further examination and re-evaluation of the data, findings, observations and conclusions expressed in this report.

We have prepared this report in accordance with the usual care and thoroughness of the consulting profession, for the sole purpose described above and by reference to applicable standards, guidelines, procedures and practices at the date of issue of this report. For the reasons outlined above, however, no other warranty or guarantee, whether expressed or implied, is made as to the data, observations and findings expressed in this report, to the extent permitted by law.

The information contained herein is for the purpose of acoustics only. No claims are made and no liability is accepted in respect of design and construction issues falling outside of the specialist field of acoustics engineering including and not limited to structural integrity, fire rating, architectural buildability and fit-for-purpose, waterproofing and the like. Supplementary professional advice should be sought in respect of these issues.

External cladding disclaimer: No claims are made and no liability is accepted in respect of any external wall and/or roof systems (eg facade / cladding materials, insulation etc) that are: (a) not compliant with or do not conform to any relevant non-acoustic legislation, regulation, standard, instructions or Building Codes; or (b) installed, applied, specified or utilised in such a manner that is not compliant with or does not conform to any relevant non-acoustic legislation, regulation, standard, instructions or Building Codes.

APPENDIX A **Field Test Certificate**

Standardized impact sound pressure levels, L'nT, in accordance with ISO 16283-2
 Field measurements of impact sound insulation of floors using the tapping machine

Client: Inspired Floorcoverings

Date of test: 01/05/2023


Description and identification of the building construction and test arrangement, direction of measurement etc.:

Floor finish in Bedroom of Unit 201:
 A sample of Inspired Floorcoverings Mist Range carpet tile adhered to 200mm concrete slab. The Mist Range specification are:
 Yarn System: 100% Solution Dyed Yarn Construction:
 High Low Loop Pile Weight: 20 Oz (567gram) Pile Height: 5.5mm Total Thickness: 7mm Gauge: 1/12
 Ceiling beneath in Bedroom of Unit 101:
 13mm standard plasterboard suspended a minimum of 100mm off slab soffit with no insulation in ceiling cavity.

Receiving room volume: 33.00 m³

Frequency f Hz	L'nT 1/3 Octave dB
50	46.1
63	49.8
80	50.2
100	51.8
125	59.5
160	56.6
200	54.0
250	48.7
315	42.1
400	39.6
500	36.8
630	33.0
800	29.0
1000	24.7 B
1250	20.6 B
1600	18.5 B
2000	17.0
2500	16.0
3150	14.3
4000	13.2
5000	11.7

B: L'nT =< value shown

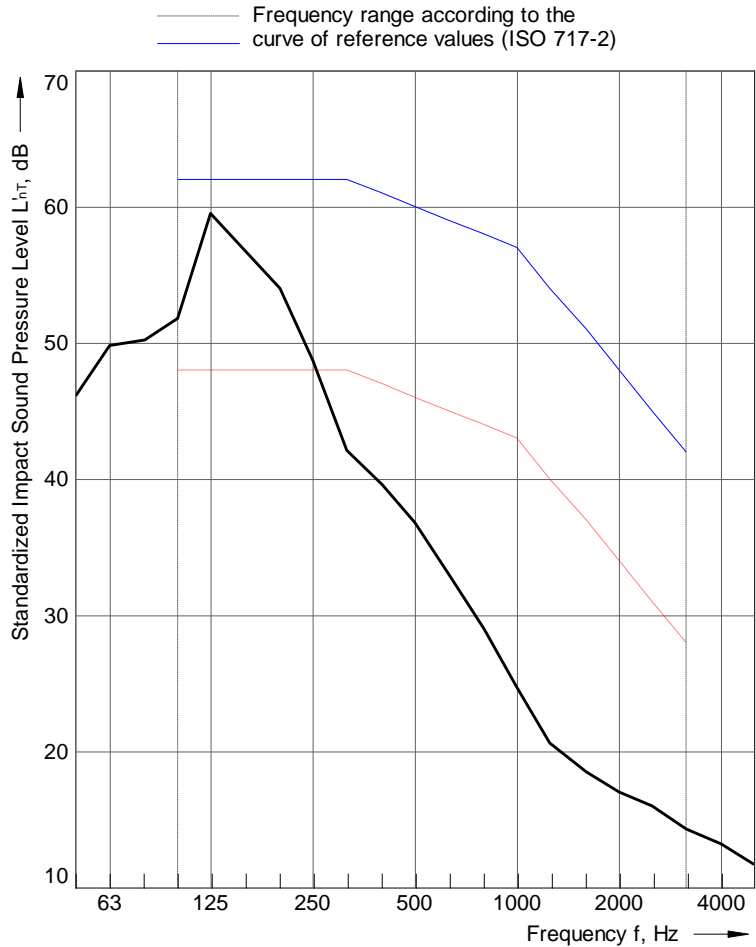

Rating according to ISO 717-2

$L'_{nT,w}(C_i) = 46 (2) \text{ dB}$

$C_{i,50-2500} = 2 \text{ dB}$

Evaluation based on field measurement results obtained in one-third-octave bands by an engineering method

No. of test report: TL238-03

Name of test institute: Renzo Tonin & Associates

Date: 01/05/2023

Signature: *[Handwritten Signature]*